



# CERTIFICATE


---

issued by

**Rittal GmbH & Co. KG**

Auf dem Stützelberg  
D-35745 Herborn

Quality Management

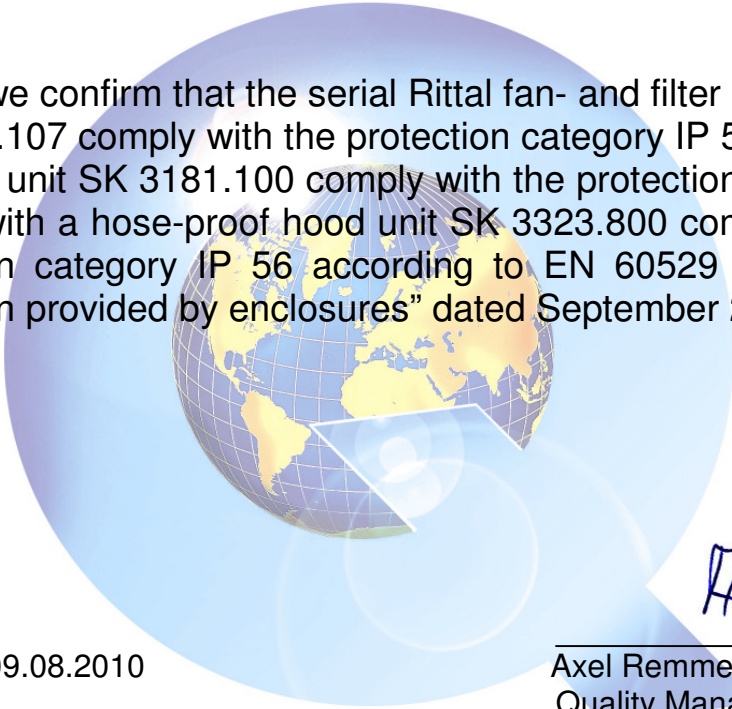

Hereby we confirm that the serial Rittal fan- and filter unit SK 3325.107 comply with the protection category IP 54 with a fine filter mat unit SK 3181.100 comply with the protection category IP 55 and with a hose-proof hood unit SK 3323.800 comply with the protection category IP 56 according to EN 60529 "Degrees of protection provided by enclosures" dated September 2000.

Herborn, 09.08.2010



---

Axel Remmert  
Quality Management Laboratory



Rittal's test laboratory is accredited with the German Accreditation Council (DAR) and Underwriters Laboratories Inc.

---

Rittal GmbH & Co. KG  
Persönlich haftend:  
Rittal Management GmbH,  
Schwende

Geschäftsführung:  
Friedhelm Loh (Vorsitzender)  
Bernd Eckel,  
Ralph Lindackers  
Dr. Thomas Steffen  
Michael Weiher

Rittal GmbH & Co. KG  
Auf dem Stützelberg  
D-35745 Herborn  
Phone: +49(0)27 72 5 05-0  
Fax: +49(0)27 72 5 05-23 19  
E-Mail: [info@rittal.de](mailto:info@rittal.de)  
[www.rittal.de](http://www.rittal.de)  
HRA 6126 Wetzlar

