

Rittal – The System.

Faster – better – everywhere.

CMC III Analogue Differential Pressure Sensor



DK 7030.150

Assembly and operating instructions

ENCLOSURES

POWER DISTRIBUTION

CLIMATE CONTROL

IT INFRASTRUCTURE

SOFTWARE & SERVICES

FRIEDHELM LOH GROUP



Foreword

EN

Foreword

Dear Customer,

Thank you for choosing our CMC III analogue differential pressure sensor (referred to hereafter as "differential pressure sensor")!

We wish you every success.

Yours

Rittal GmbH & Co. KG

Rittal GmbH & Co. KG
Auf dem Stuetzelberg

35745 Herborn
Germany

Tel.: +49(0)2772 505-0
Fax: +49(0)2772 505-2319

E-mail: info@rittal.com
www.rittal.com
www.rittal.de

We are always happy to answer any technical questions regarding our entire range of products.

Contents

1	Notes on documentation	4
1.1	CE labelling	4
1.2	Storing the documents	4
1.3	Symbols used in these operating instructions	4
1.4	Associated documents	4
2	Safety instructions	5
2.1	General safety instructions	5
2.2	Service and technical staff	5
3	Product description	6
3.1	Function description and components	6
3.1.1	Function	6
3.1.2	Components	6
3.2	Proper use, foreseeable misuse	6
3.3	Scope of supply	6
4	Transport and handling	7
4.1	Transport	7
4.2	Unpacking	7
5	Installation	8
5.1	Safety instructions	8
5.2	Siting location requirements	8
5.3	Installation procedure	8
5.3.1	Installation notes	8
5.3.2	Installation with the provided bracket on the enclosure frame	8
5.3.3	Installation with the provided bracket on a system chassis	9
5.3.4	Installation on a top-hat rail	9
5.4	Connecting the sensor	10
6	Operation	11
6.1	Activating the differential pressure sensor ...	11
6.2	Operating and display elements	11
6.3	LED displays	11
6.3.1	Multi-LED displays	11
6.3.2	LED displays on the CAN bus connection	11
6.4	Operating the CMC III Processing Unit from the website	11
6.4.1	Device	11
6.4.2	Pressure	12
7	Storage and disposal	13
7.1	Storage	13
7.2	Disposal	13
8	Technical specifications	14
9	Customer service addresses	15

1 Notes on documentation

1.1 CE labelling

Rittal GmbH & Co. KG hereby confirms that the CMC III analogue differential pressure sensor is compliant with the EC EMC Directive 2014/30/EU. An appropriate declaration of conformity has been prepared. It can be provided on request.



1.2 Storing the documents

The operating, installation and maintenance instructions as well as all applicable documents are an integral part of the product. They must be passed to those persons who are engaged with the unit and must always be available and on hand for the operating and maintenance personnel.

1.3 Symbols used in these operating instructions

The following symbols are used in this documentation:



Danger!

A dangerous situation in which failure to comply with the instructions causes death or severe injury.



Warning!

A hazardous situation which may lead to death or serious injury if the instructions are not followed.



Caution!

A hazardous situation which may lead to (minor) injuries if the instructions are not followed.



Note:

Identification of situations that can lead to material damage.

- This symbol indicates an "action point" and shows that you should perform an operation or procedure.

1.4 Associated documents

- Installation and Short User's Guide
- CMC III Processing Unit/CMC III Processing Unit Compact assembly and operating instructions

2 Safety instructions

2.1 General safety instructions

Please observe the subsequent general safety instructions for the installation and operation of the system:

- Use only original Rittal products or products recommended by Rittal in conjunction with the differential pressure sensor.
- Please do not make any changes to the differential pressure sensor that are not described in this manual or in the associated manuals.
- The operational safety of the differential pressure sensor is guaranteed only for its approved use. The technical specifications and limit values stated may not be exceeded under any circumstances. In particular, this applies to the specified ambient temperature range and IP degree of protection.
- The differential pressure sensor may not be opened. The unit does not contain any parts that need servicing.
- Operating the system in direct contact with water, aggressive materials or inflammable gases and vapours is prohibited.
- Other than these general safety instructions, ensure you also observe the specific safety instructions when the tasks described in the following chapters are performed.

2.2 Service and technical staff

- The mounting, installation, commissioning, maintenance and repair of this unit may only be performed by qualified mechanical and electro-technical trained personnel.
- Only properly instructed personnel may work on a unit while in operation.

3 Product description

3.1 Function description and components

3.1.1 Function

The differential pressure sensor serves to monitor the differential pressure for climate control applications, e.g. raised floor cooling, cold aisle enclosure, etc. It delivers the pressure measurements to the connected CMC III Processing Unit. The differential pressure sensor has an identification that allows it to be detected automatically by the CMC III Processing Unit.



Note:

In the following text the designation "CMC III Processing Unit" refers to both the "CMC III Processing Unit" and also the "CMC III Processing Unit Compact". All of the text passages which only apply for one of the two variants are labelled accordingly.

3.1.2 Components

The device consists of a compact plastic housing in RAL 7035 with a ventilated front in RAL 9005.

3.2 Proper use, foreseeable misuse

The differential pressure sensor serves exclusively to monitor the differential pressure for climate control applications using the air hose included in the scope of delivery, e.g. in a cold aisle. It may only be used together with the CMC III Processing Unit. Any other use is not permitted.

3.3 Scope of supply

- CMC III analogue differential pressure sensor
- Accessories provided (fig. 1)
- Installation and Short User's Guide

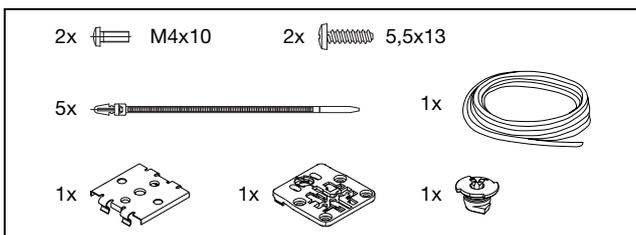


Fig. 1: Accessories provided

4 Transport and handling

4.1 Transport

The unit is delivered in a carton.

4.2 Unpacking

- Remove the unit's packaging materials.



Note:

After unpacking, the packaging materials must be disposed of in an environmentally friendly way. It consists of the following materials:

Polyethylene film (PE film), cardboard.

- Check the unit for any damage that occurred during transport.



Note:

Damage and other faults, e.g. incomplete delivery, should immediately be reported to the shipping company and to Rittal GmbH & Co. KG in writing.

- Remove the unit from the PE film.
- Remove the protective film from the front cover of the device.

5 Installation

EN

5 Installation

5.1 Safety instructions

- Please observe the valid regulations for installation in the country in which the differential pressure sensor is installed and operated, and the national regulations for accident prevention. Please also observe any company-internal regulations, such as work, operating and safety regulations.
- The technical specifications and limit values stated must not be exceeded under any circumstances. In particular, this applies to the specified ambient temperature range and IP degree of protection.
- If a higher IP protection class is required for a special application, the differential pressure sensor must be installed in an appropriate housing or in an appropriate enclosure with the required IP degree of protection.

5.2 Siting location requirements

To ensure the correct function of the unit, the conditions for the installation site of the unit specified in section 8 "Technical specifications" must be observed.

Electromagnetic interference

- Interfering electrical installations (high frequency) should be avoided.

5.3 Installation procedure

There are generally several options for installing the differential pressure sensor:

1. Installation on the frame of the enclosure or IT enclosure using the bracket included.
2. Installation with the provided bracket on a system chassis.
3. Installation on a top-hat rail using the bracket included along with a spring clip.

5.3.1 Installation notes

- The differential pressure sensor must be positioned so that it is ventilated with an adequate amount of air and the ventilation slots are not covered.

5.3.2 Installation with the provided bracket on the enclosure frame

The provided bracket is used for installation on the frame of an IT enclosure.

- For installation on a TS IT enclosure, break off the protruding lugs at the rear of the bracket.

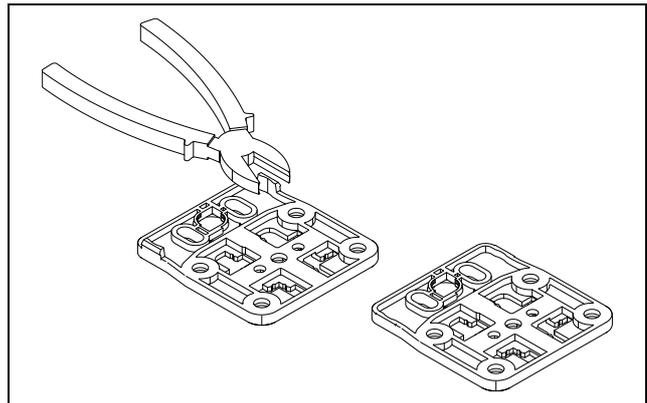


Fig. 2: Preparing the bracket for installation on a TS IT enclosure

- Place the differential pressure sensor on the bracket from above.

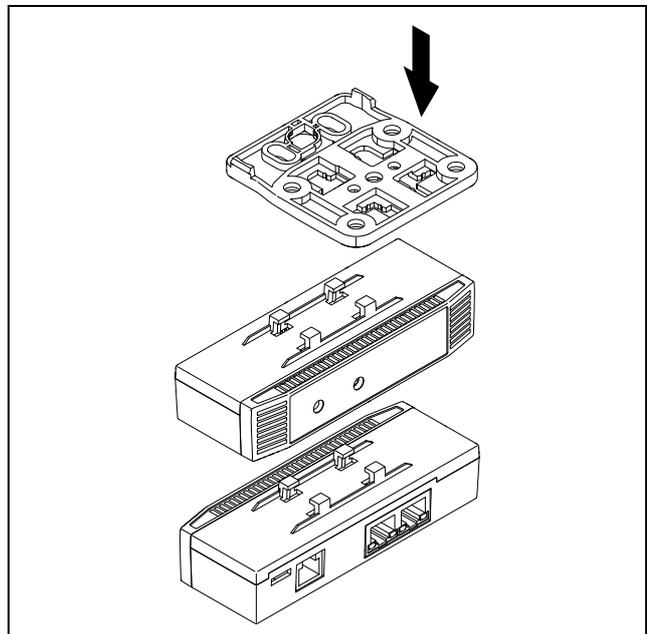


Fig. 3: Attaching the sensor to the bracket

- Move the sensor sideways slightly on the bracket so that it latches into place.

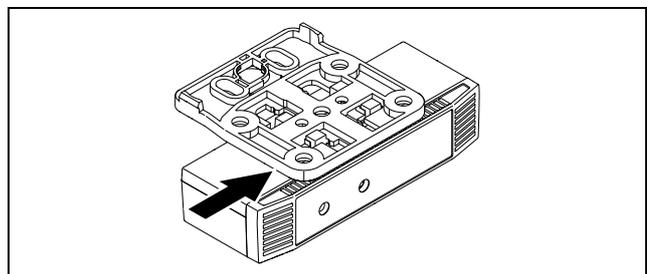


Fig. 4: Latching the sensor into place on the bracket

- Fasten the bracket, including differential pressure sensor, at the desired position in the enclosure or the IT enclosure by making a quarter-turn of the connector.

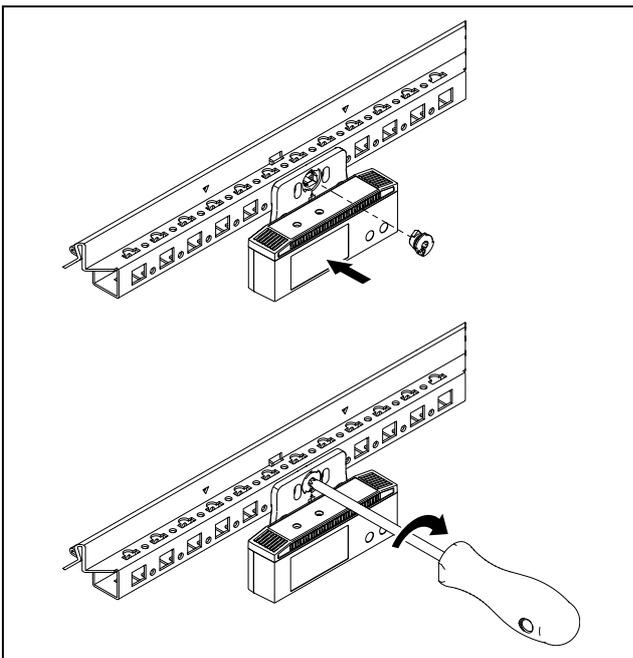


Fig. 5: Mounting the sensor in the enclosure or IT enclosure

- Optionally secure the bracket using the two screws included in the scope of delivery.

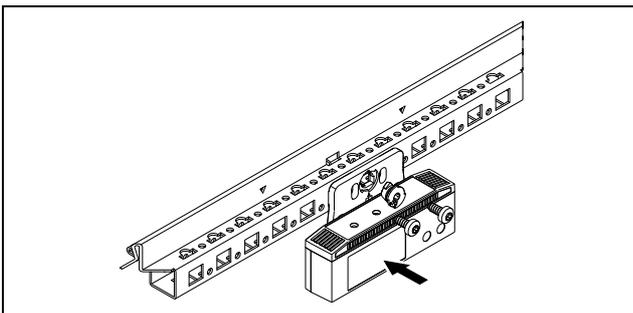


Fig. 6: Optional securing of the bracket

5.3.3 Installation with the provided bracket on a system chassis

The provided bracket is used for installation on a system chassis.

- Place the differential pressure sensor on the bracket from above and latch it similar to the installation on the enclosure frame.
- Fasten the bracket, including differential pressure sensor, at the desired position in the enclosure on the system chassis by making a quarter-turn of the connector.

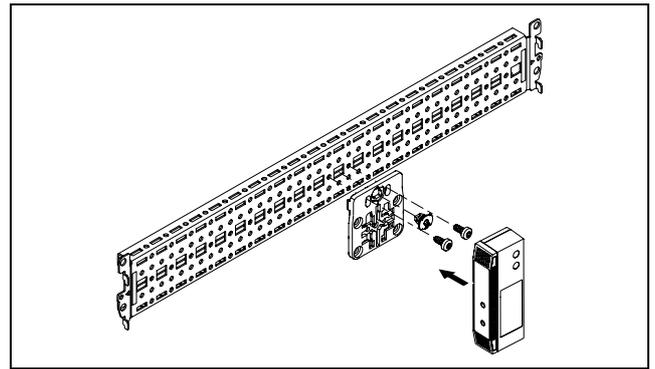


Fig. 7: Fastening the sensor to a system chassis

- Also **always** secure the bracket with the two provided bolts.

5.3.4 Installation on a top-hat rail

The sensor can also be mounted on a top-hat rail using the bracket along with the spring clip included in the scope of delivery.

- First screw the bracket onto the spring clip provided for installation on a top-hat rail.
- Then place the differential pressure sensor on the bracket and latch it into place.

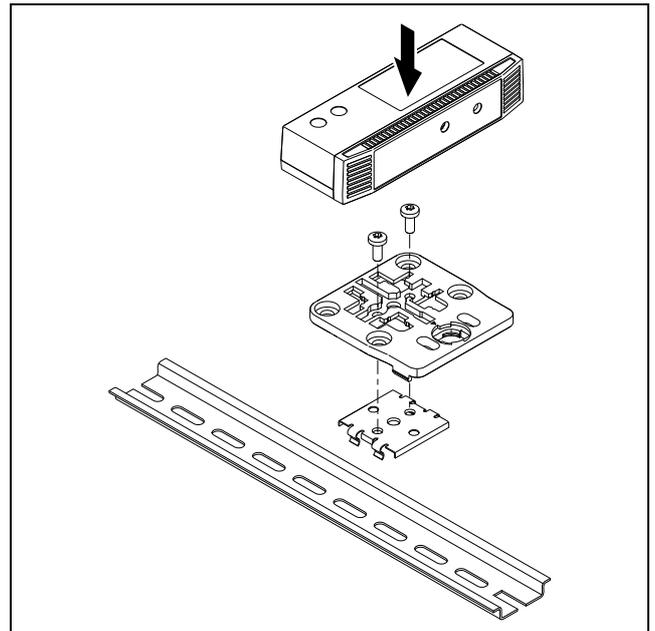


Fig. 8: Fastening the bracket to the spring clip

- Latch the spring clip into place at the desired position on the top-hat rail.

5 Installation

EN

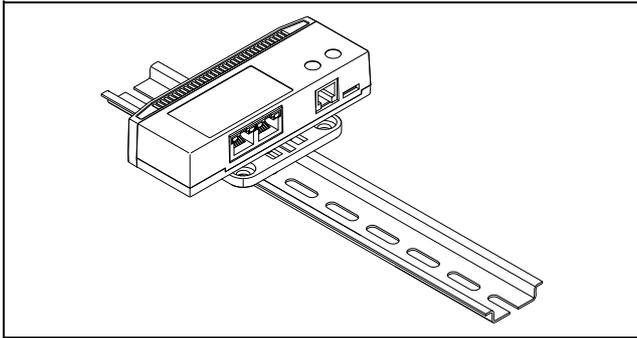


Fig. 9: Sensor with spring clip on the top-hat rail

5.4 Connecting the sensor

The CAN bus connection supplies the differential pressure sensor with the necessary operating voltage. A separate power supply unit does not need to be connected.

- Connect the air hose for the reference measurement to the appropriate connection (fig. 10, item 2).
- Connect the air hose for the comparison measurement to the appropriate connection (fig. 10, item 1).

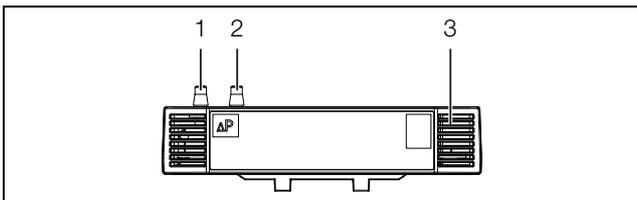


Fig. 10: Front of the differential pressure sensor

Key

- 1 Connection – for air hose (lower pressure value)
- 2 Connection + for air hose (higher pressure value)
- 3 Multi-LED for status display

- Run the two air hoses to the corresponding measurement point.
- Use a CAN bus connection cable to connect the differential pressure sensor to a CAN bus interface on the CMC III Processing Unit or the neighbouring component on the CAN bus (fig. 11, item 4).

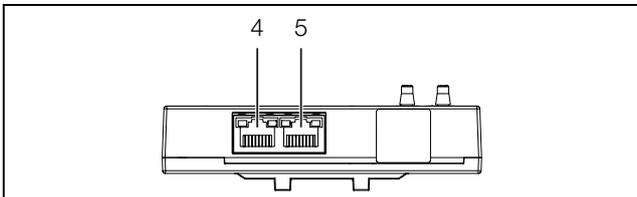


Fig. 11: Rear of the differential pressure sensor

Key

- 1 CAN bus connection, 24 V $\overline{\text{---}}$
- 2 CAN bus connection, 24 V $\overline{\text{---}}$

The following CAN bus connection cables from the CMC III accessories can be used:

- DK 7030.090 (length 0.5 m)
- DK 7030.091 (length 1 m)
- DK 7030.092 (length 1.5 m)
- DK 7030.093 (length 2 m)

- DK 7030.480 (length 3 m)
- DK 7030.490 (length 4 m)
- DK 7030.094 (length 5 m)
- DK 7030.095 (length 10 m)

The software is updated, if necessary, after being connected. The status LED of the differential pressure sensor glows blue throughout the entire update process and also flashes purple while the sensor itself receives an update.

In addition, the status LED of the CMC III Processing Unit flashes white and a corresponding message appears on the website.



Note:

No settings can be modified as long as the update process is running.

The update of the sensor is complete when the following conditions have been fulfilled:

1. The LEDs on the CAN bus connection of the sensor light green.
2. The multi-LED of the sensor behind the front panel flashes blue and green, yellow or red, depending on the condition of the sensor.

Further components are connected as a daisy chain.

- If necessary, connect another component (e.g. another sensor type) to the second, free CAN bus interface of the differential pressure sensor (fig. 11, Item 5).

Status change display:

- The two green and the two red CAN bus LEDs on the CAN bus connection flash.
- The multi-LED of the Processing Unit flashes continually in the sequence green – orange – red.
- The multi-LED of the differential pressure sensor flashes blue continuously.
- Press the "C" key on the CMC III Processing Unit (an initial audio signal will sound) and keep it pressed for approx. 3 seconds until a second audio signal is heard.



Note:

See section 6.3.1 "Multi-LED displays" for a list of all of the multi-LED displays.

6 Operation

6.1 Activating the differential pressure sensor

After connecting the differential pressure sensor to a neighbouring component using a CAN bus connecting cable, the differential pressure sensor starts automatically (see section 5.4 "Connecting the sensor"). Separate activation is not required.

6.2 Operating and display elements

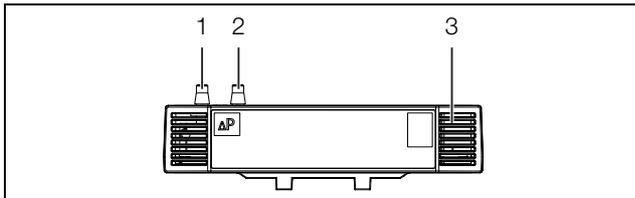


Fig. 12: Front of the differential pressure sensor

Key

- 1 Connection – for air hose (lower pressure value)
- 2 Connection + for air hose (higher pressure value)
- 3 Multi-LED for status display

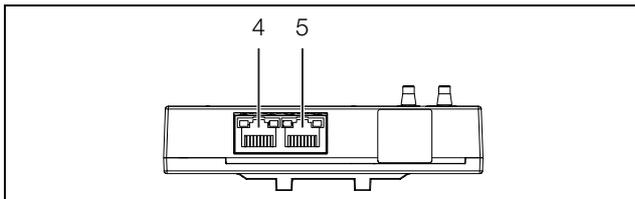


Fig. 13: Rear of the differential pressure sensor

Key

- 1 CAN bus connection, 24 V $\overline{\text{---}}$
- 2 CAN bus connection, 24 V ---

6.3 LED displays

A multi-LED for the status display is integrated into the front of the differential pressure sensor (fig. 12, item 3). Further LEDs are located at the rear on the CAN bus connection (fig. 13, item 4 and item 5).

6.3.1 Multi-LED displays

The status of the differential pressure sensor can be read on the multi-LED.

Continuously lit

Colour	Status
Red	Invalid measured value

Tab. 1: Multi-LED continuously lit

Flashing codes

Colour	Status
Green	When the measured value changes or, at the latest, every 5 seconds.

Tab. 2: Multi-LED flashing codes

Colour	Status
Orange	The differential pressure sensor has the "warning" status. Fast flashing: upper limit value overshoot. Slow flashing: lower limit value undershoot.
Red	The differential pressure sensor has the "alarm" status. Fast flashing: upper limit value overshoot. Slow flashing: lower limit value undershoot.
Blue	Communication via the CAN bus.

Tab. 2: Multi-LED flashing codes

6.3.2 LED displays on the CAN bus connection

A red and a green LED are located on the CAN bus connection. They display the status of the CAN bus.

Colour	Status
Green (continuously lit)	Communication via the CAN bus possible.
Red (flashing)	Transmission fault.

Tab. 3: LEDs for the CAN bus connection

6.4 Operating the CMC III Processing Unit from the website

After logging on to the CMC III Processing Unit, the web interface for operating the device is displayed.

- First select the "CMCIII-DIF" entry in the navigation area.

Similar to the CMC III Processing Unit, the **Configuration** tab can be used to individually configure the access rights for the differential pressure sensor (**Access Rights** button) and the alarm messages (**Alarm Configuration** button).

The **Observation** tab is used to configure all of the settings for the differential pressure sensor, such as the limit values for warning and alarm messages.

In the following sections 6.4.1 "Device" and 6.4.2 "Pressure", only those parameters which you can modify are described. There are also display values that provide information.

6.4.1 Device

General settings for the differential pressure sensor are configured at the "Device" level.

Parameter	Explanation
Description	Specific description of the differential pressure sensor.

Tab. 4: Settings in the "Device" level

Parameter	Explanation
Location	Installation location of the differential pressure sensor.

Tab. 4: Settings in the "Device" level

In addition, parameters that provide detailed information about the differential pressure sensor, such as the version of the deployed software and hardware, are also displayed. You should have such information available, in particular to permit fast troubleshooting of queries with Rittal.

6.4.2 Pressure

Differential pressure measurement settings are configured on the "Pressure" level.

Parameter	Explanation
DescName	Specific description of the differential pressure measurement.
SetPtHigh-Alarm	Upper limit of the differential pressure; an alarm message is output if this is exceeded.
SetPtHigh-Warning	Upper limit of the differential pressure; a warning message is output if this is exceeded.
SetPtLow-Warning	Lower limit of the differential pressure; a warning message is output if this is fallen below.
SetPtLow-Alarm	Lower limit of the differential pressure; an alarm message is output if this is fallen below.
Hysteresis	The necessary percentage deviation for falling below or exceeding the limit for the differential pressure to trigger a status change (see the assembly, installation and operating instructions for the CMC III Processing Unit).

Tab. 5: Settings in the "Pressure" level

The following parameters are also displayed for the differential pressure sensor:

Parameter	Explanation
Value	Currently measured differential pressure.
Status	Current status of the sensor, taking into account the ' hysteresis.

Tab. 6: Displays in the "Pressure" level



Note:

If the value "0" is entered for all limit values at the "Pressure" level, the status of the sensor is always "OK".

7 Storage and disposal

7.1 Storage

If the device is not used for a long period, Rittal recommends that it is disconnected from the mains power supply and protected from damp and dust.

7.2 Disposal

Since the differential pressure sensor consists mainly of the "housing" and "circuit board" parts, the device must be passed on to the electronic waste recycling system for disposal.

8 Technical specifications

EN

8 Technical specifications

Technical specifications		CMC III differential pressure sensor
Model no.		DK 7030.150
W x H x D (mm)		110 x 30 x 40
Operating temperature range		0 °C...+55 °C
Storage temperature		-45 °C...+85 °C
Operating humidity range		5%...95% relative humidity, non-condensing
Number of pressure measurement points		2
Measurement range		-500 Pa...+500 Pa
Measurement precision		± 3%
Resolution		1.0 Pa
Protection category		IP 30 to IEC 60 529
Inputs and outputs	CAN bus (RJ 45)	2 x
	Air hose connections	2 x
Operation/signals	LED display	OK / warning / alarm / network status

Tab. 7: Technical specifications

9 Customer service addresses

For technical queries, please contact:

Tel.: +49(0)2772 505-9052

E-mail: info@rittal.com

Homepage: www.rittal.com

For complaints or service requests, please contact:

Tel.: +49(0)2772 505-1855

E-mail: service@rittal.de

Rittal – The System.

Faster – better – everywhere.

- Enclosures
- Power Distribution
- Climate Control
- IT Infrastructure
- Software & Services

You can find the contact details of all Rittal companies throughout the world here.



www.rittal.com/contact

RITTAL GmbH & Co. KG
Auf dem Stuetzelberg · 35745 Herborn · Germany
Phone +49 2772 505-0
E-mail: info@rittal.de · www.rittal.com

08.2022 / D-0000-000003087-00-EN

ENCLOSURES

POWER DISTRIBUTION

CLIMATE CONTROL

IT INFRASTRUCTURE

SOFTWARE & SERVICES

FRIEDHELM LOH GROUP

