


Rittal – The System.

Faster – better – everywhere.

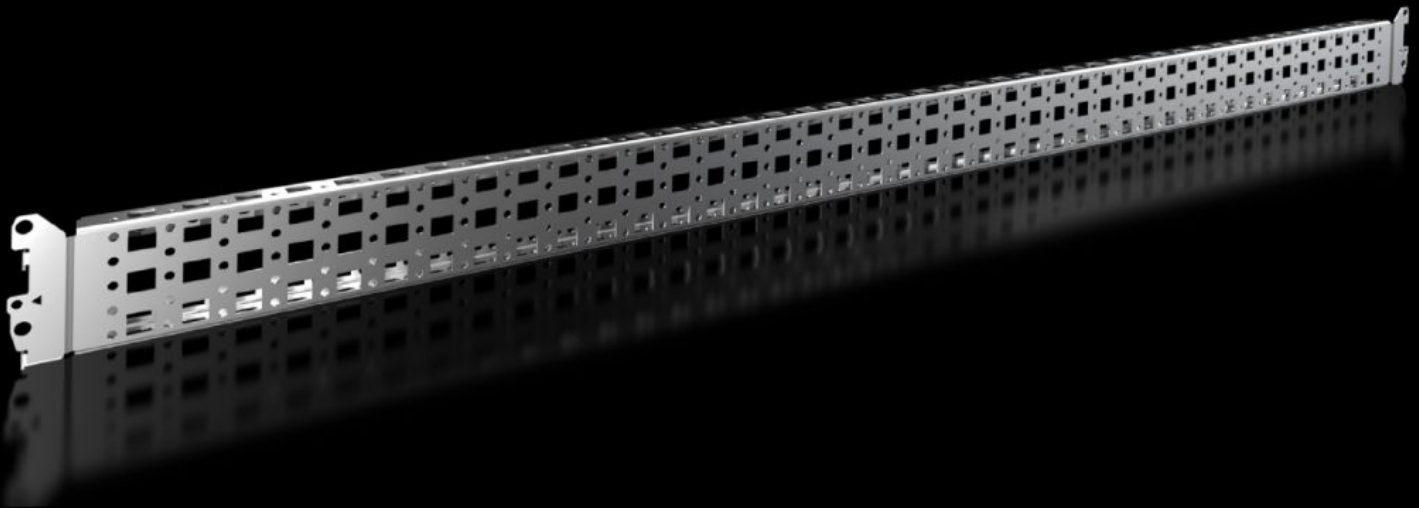

VX 8617.160

System chassis 23 x 64 mm

State: 2026-07-07 (Source: [rittal.com/ca-en](https://www.rittal.com/ca-en))

ENCLOSURES

POWER DISTRIBUTION

CLIMATE CONTROL

IT INFRASTRUCTURE

SOFTWARE & SERVICES

FRIEDHELM LOH GROUP



VX 8617.160 - System chassis 23 x 64 mm for VX, VX IT, VX SE, AX plastic

For variable and individual interior fitting of the enclosure frame on the inner mounting level and for installation in compact control enclosures.



Features

Model No.	VX 8617.160
Product description	For variable and individual interior fitting of the enclosure frame on the inner mounting level and for installation in compact control enclosures.
Benefits	Simply place in the system punchings and screw-fasten System punchings on all four sides With slots at the top and bottom for cage nuts, for attaching your own components via metric screws
Material	Carbon steel
Surface finish	Zinc-plated
Supply includes	Assembly components
Installation options VX	In enclosure width/height/depth 1200 mm, on the inner mounting level
Installation options VX SE	In enclosure width 1200 mm, on the inner mounting level, in conjunction with adaptor rail for VX compatibility and in the base
Installation options AX	In enclosure width/height 1200 mm, in conjunction with rail for interior installation AX and base configuration rail for AX

Features

Installation options AX stainless steel	In enclosure height/width 1,200 mm, in conjunction with the base configuration rail
Installation options VX Base	In base/plinth width/depth 1,200 mm on the base/plinth panels, in conjunction with base/plinth installation bracket
Suitable for	Enclosure type: VX VX IT VX SE AX Suitable for width or height or depth: 1,200 mm
Suitable for	VX base system
Packaging unit	4 pc(s).
Net weight	4.8 kg
Gross weight	5.12 kg
PCF/VE (cradle-to-gate)	26.59
Customs tariff number	73269098
ETIM 9	EC002620
ECLASS 8.0	27189234
Product description	VX Punched section, with mounting flange 23 x 64 mm, for inner mounting level

Approvals

Explanations	PCF-declaration
--------------	-----------------