


Rittal – The System.

Faster – better – everywhere.

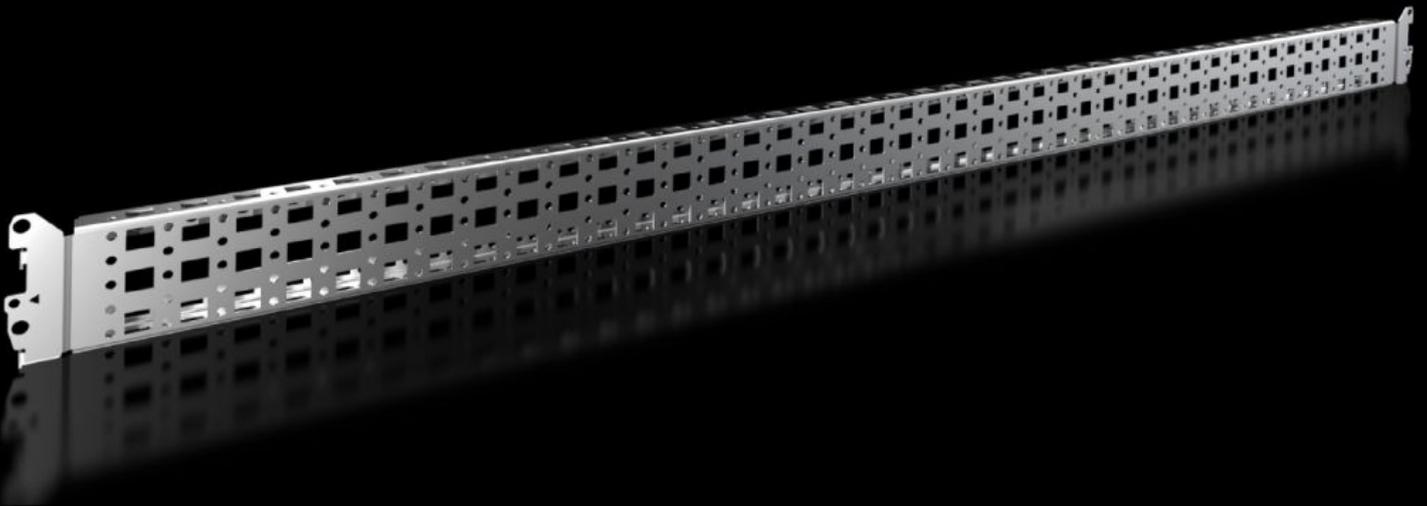

VX 8617.160

**Punched section with mounting
flange, 23 x 64 mm**

State: 17/04/2026 (Source: rittal.com/com-en)

ENCLOSURES

POWER DISTRIBUTION

CLIMATE CONTROL

IT INFRASTRUCTURE


SOFTWARE & SERVICES

FRIEDHELM LOH GROUP



VX 8617.160 - Punched section with mounting flange, 23 x 64 mm for VX, VX IT, VX SE, AX plastic

For variable, individual interior installation of the enclosure frame on the inner mounting level, and for installation in compact enclosures.

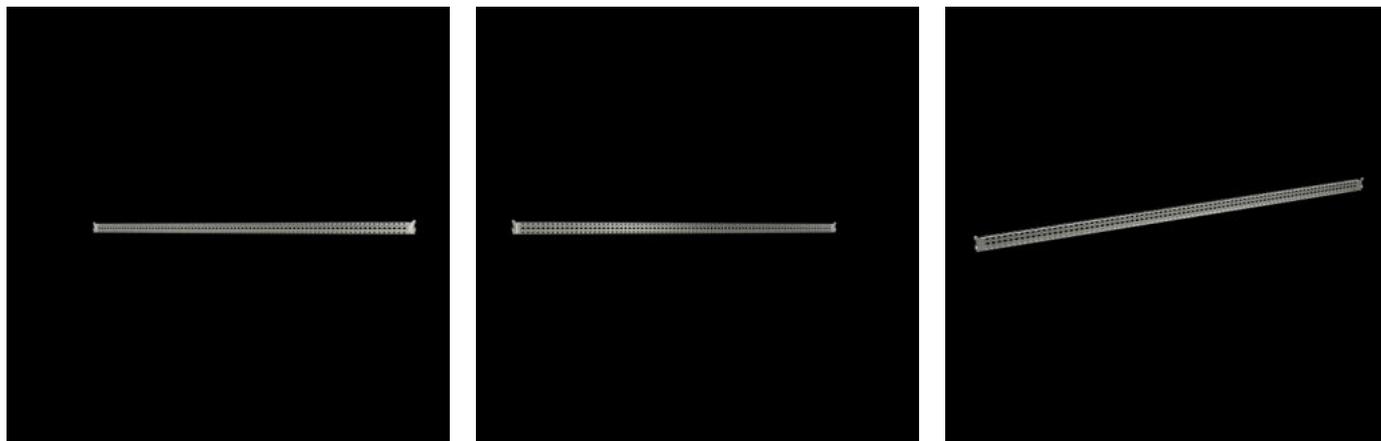

Features

Model No.	VX 8617.160
Product description	For variable, individual interior installation of the enclosure frame on the inner mounting level, and for installation in compact enclosures.
Benefits	Simply locate into the system punchings and screw-fasten System punchings on all four sides With slots at the top and bottom for cage nuts, for attaching your own components via metric screws
Material	Sheet steel
Surface finish	Zinc-plated
Supply includes	Assembly parts
VX installation options	In enclosure width/height/depth 1200 mm, on the inner mounting level
VX SE installation options	In enclosure width 1200 mm, on the inner mounting level, in conjunction with adaptor rail for VX compatibility and in the base
AX installation options	In enclosure width/height 1200 mm, in conjunction with rail for interior installation AX and base configuration rail for AX

Features

AX stainless steel installation options	In enclosure height/width 1200 mm, in conjunction with the base configuration rail
VX base/plinth installation options	In base/plinth width/depth 1200 mm on the base/plinth trim panels, in conjunction with base/plinth installation bracket
To fit	Enclosure type: VX VX IT VX SE AX Suitable for width or height or depth: 1,200 mm
To fit	Base/plinth system VX
Packs of	4 pc(s).
Net weight	4.8 kg
Gross weight	5.12 kg
Customs tariff number	73269098
ETIM 9	EC002620
ECLASS 8.0	27189234
Product description	VX Punched section, with mounting flange 23 x 64 mm, for inner mounting level

Approvals

Explanations	PCF-declaration
--------------	-----------------